
Design of Beam Based On BIM Method Using Autodesk Revit and Autodesk RSAP

Lusivatul Khasanah¹

Universitas 17 Agustus 1945 Surabaya, Indonesia
E-mail : lusivatulk1124@gmail.com

Ibnusina Wirakusuma²

Inspektorat Daerah Pemerintah Kabupaten Sidoarjo
E-mail : ibnusina.wirakusuma@gmail.com

Abstrak

Dengan berkembangnya industri Architecture, Engineering and Construction (AEC) banyak software yang dikembangkan untuk memenuhi kebutuhan industri konstruksi dengan tujuan untuk meminimalisir human eror dikarenakan pengolahan data secara konvensional. Revit dan Robot Structural Analysis Profesional adalah sebuah software penunjang metode BIM yang diterbitkan oleh Autodesk dan saling terintegrasi satu sama lain. Autodesk Revit merupakan software yang digunakan untuk desain 3D, perencanaan scheduling dan perencanaan anggaran biaya, sedangkan Robot Structural Analysis Profesional merupakan software yang digunakan untuk analisis struktur. Tujuan dari penelitian ini adalah untuk membuat desain optimum elemen balok menggunakan software RSAP yang kemudian akan dilakukan pengecekan terhadap peraturan SNI 2847:2019. Metode dalam penelitian ini dilakukan dengan merencanakan ulang salah satu gedung fasilitas pendidikan yang ada di Kota Surabaya menggunakan Autodesk Revit dan Autodesk RSAP. Penelitian ini menghasilkan desain optimum elemen balok serta perbandingan penulangan menggunakan metode BIM dan metode konvensional. Dari hasil analisis dan pembahasan dapat disimpulkan bahwa Software RSAP untuk desain balok yang optimal dapat dikatakan lebih boros dari hasil perhitungan konvensional menggunakan SNI 2847:2019, hal ini dikarenakan keterbatasan dalam mengatur jumlah tulangan yang tidak dapat dirubah pada software RSAP.

Kata Kunci : Autodesk Revit, Autodesk Robot Structural Analysis Profesional (RSAP), Building Information Modelling (BIM), Integrasi.

Abstract

With the development of the Architecture, Engineering and Construction (AEC) industry, a lot of software has been developed to meet the needs of the construction industry with the aim of minimizing human error due to conventional data processing. Revit and Robot Structural Analysis Profesional software supporting the BIM method published by Autodesk and integrated with each other. Autodesk Revit is software used for 3D design, scheduling planning and budget planning, while Robot Structural Analysis Professional is software used for structural analysis. The purpose of this research is to make an optimum design of beam elements using RSAP software which will then be checked against SNI 2847:2019 regulations. The method in this study was

carried out by re-planning one of the existing educational facility buildings in the city of Surabaya using Autodesk Revit and Autodesk RSAP. This research resulted in the optimum design of beam elements and comparison of reinforcement using the BIM method and conventional methods. From the results of the analysis and discussion it can be concluded that the RSAP Software for optimal beam design can be said to be more wasteful than the results of conventional calculations using SNI 2847: 2019, this is due to limitations in setting the amount of reinforcement which cannot be changed in the RSAP software.

Keywords: *Autodesk Revit, Autodesk Robot Structural Analysis Profesional (RSAP), Building Information Modelling (BIM), Integration.*

1. BACKGROUND

With the development of the Architecture, Engineering and Construction (AEC) industry, a lot of software has been developed to meet the needs of the construction industry with the aim of minimizing human error due to conventional data processing. This requires the Indonesian people to evaluate construction management methods in their implementation [1]. Building Information Modeling (BIM) is a paradigm shift to replace conventional CAD [2]. Building Information Modeling (BIM) is able to simulate all project information or data processing in 3 dimensions. The use of BIM provides many advantages in implementing a project. As is the case with BIM technology, accurate virtual models can be created digitally. BIM enables integrated design and construction processes to achieve better results, lower project costs and timeframes. BIM can also improve and perfect project development as needed starting from the planning stage, field implementation, to completion and maintenance stages

Revit is software for modeling, where each building element is identified based on its function, including technical data and price. *Revit* can create 3D modeling that includes the physical properties and interactions between construction components. Such as when making changes or modifications to a view, these changes will affect other displays and will automatically change. Meanwhile, *Autodesk Robot Structural Analysis Professional* is a new structural design and analysis software designed to simplify the process of calculating structural loading.

The purpose of this research is to make an optimum design of beam elements in one of the educational facility buildings in the city of Surabaya using the RSAP software which will then be checked against the SNI 2847:2019 regulations. The reason for choosing the Building Information Modeling (BIM) based method is so that the implementation of a construction work becomes more effective and efficient. By using the BIM method, construction companies can save processing time, costs and the required manpower. It can also minimize errors in the implementation of a development by using a technology in the field of construction that has covered all disciplinary aspects of the field of construction work using Building Information Modeling (BIM) technology.

2. RESEARCH METHODOLOGY

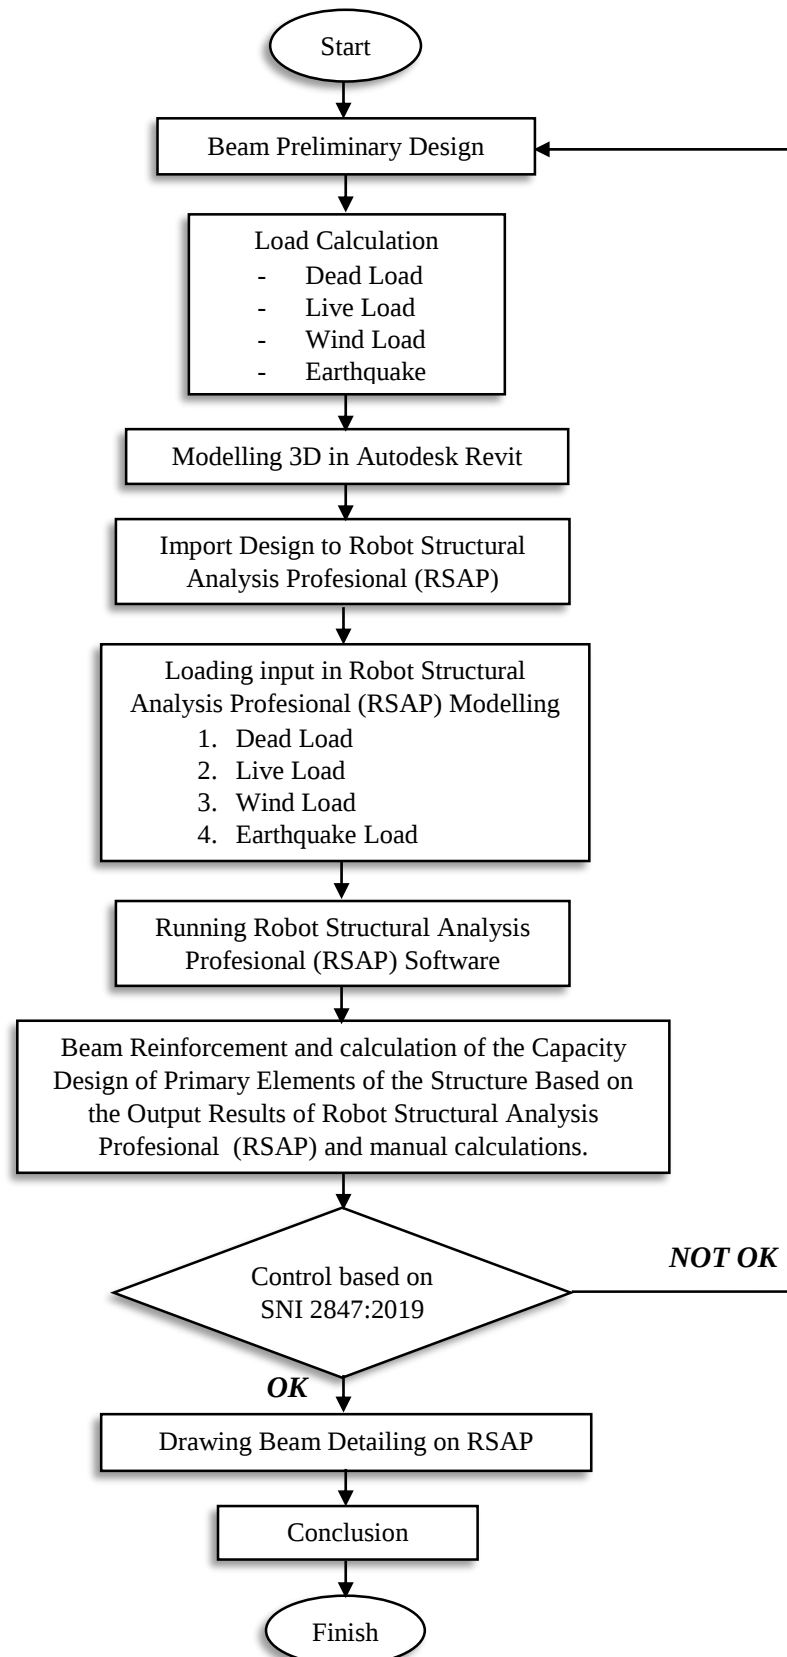


Figure 1 Flow Chart

2.1 Loading Calculation Data

2.1.1 Gravity Load

a. Dead Load

Dead Load in the form of the Building Structure load itself will be modeled into the *Robot Structural Analysis Profesional* software and will automatically be calculated by the software itself.

b. Super Dead Load

Super Dead Load is a dead load that is not modeled but needs to be inputted directly into the software in the form of load values in the Indonesian Loading Regulation for Buildings 1983 (PPIUG 1983) as follows :

Table 1 Dead Load based on PPIUG 1983

Load Type	Weight (kg/m ²)
Reinforcement Concrete	2400
Spent	21
Ceramics	24
a Half Brick Wall	250
Ceiling	11
Ceiling Hanger	7
Instalation of MEP	25

(Source : PPIUG 1983)

c. Live Load

The loading of the live load to be calculated refers to the regulation SNI 1727:2020 concerning Minimum Load for the Design of Buildings and Other Structures, as follows :

Table 2 Minimum evenly distributed live load, L_0 and minimum centralized live load

Occupancy or Use	Evenly, L_0 (kN/m ²)	Centralized (kN)	Evenly, L_0 (kg/m ²)	Centralized (kg)
School				
Class Room	1,92	4,45	195,78	453,77
Above the first floor Corridor	3,83	4,45	390,55	453,77
First floor corridor	4,79	4,45	488,44	453,77
Roof				
Roof for a gathering place	4,79		488.44	

(Source : SNI 1727:2020 Chapter 4.3)

2.1.2 Wind Load

In the calculation of wind load, the data used adjusts to geographical and climatological conditions at the project location. The basic wind speed data to be used in the calculation of wind load using data from the Central Statistics Agency (BPS) in the two-year data range from 2019 to 2020, get the wind speed value is $V = 33$ m/s.

2.1.3 Earthquake Load

Earthquake load analysis used spectrum response analysis which is analyzed using RSA2019 software with Building Risk Category is IV dan Soil Site Classification is SE / Soft Soil. Get the graph of spectrum response analysis as follows :

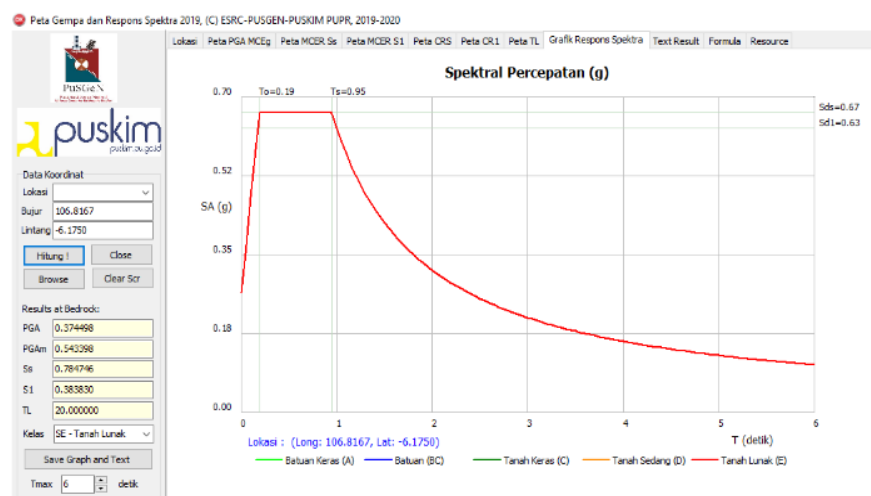


Figure 2 Spectral Values Design

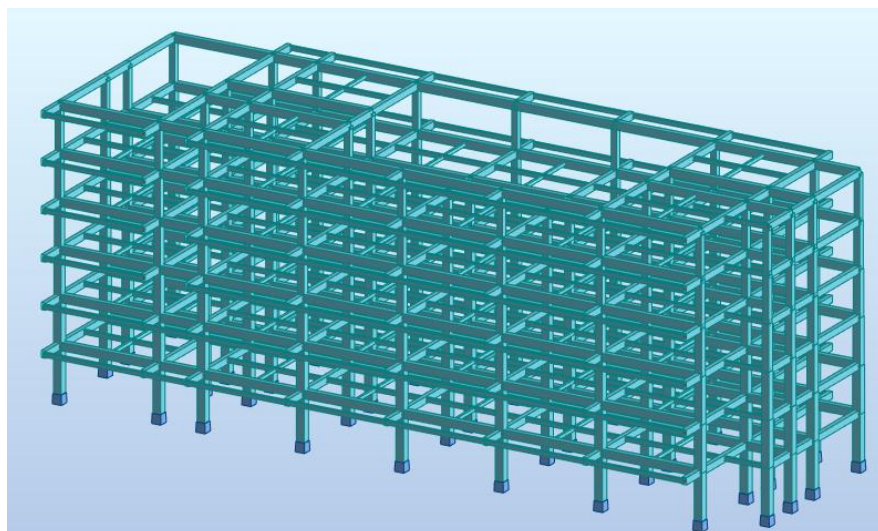


Figure 3 Structural Modelling in Robot Structural Analysis Profesional

3. RESULT AND DISCUSSION

3.1 Preliminary Design

From the calculations of beam preliminary design, the results of the dimensions beam will be used in the design as follows :

Table 3 Beam Preliminary Design Result

No	Element	Dimensions (cm)	
		b	h
1.	Elongated Main Beam (BI1)	40	60
2.	Transverse Main Beam (BI2)	35	50
3.	Elongated Joist (BA1)	25	35
4.	Transverse Joist (BA2)	20	30

Checking the Beam Dimension Requirements According to SNI 2847:2019 Chapter 18.6.2.1 Page 377, for the checking example used one of elongated main beam, as follows :

1. Clean Span Requirement ($l_n \geq 4d$)

- X Direction Clean Span Check
 $l_{nx} \geq 4d$
 $8250 \text{ mm} \geq 4 \times 539 \text{ mm} = 8250 \text{ mm} \geq 2156 \text{ mm}$ (*Qualify*)
- Y Direction Clean Span Check
 $l_{ny} \geq 4d$
 $6450 \text{ mm} \geq 4 \times 539 \text{ mm} = 6450 \text{ mm} \geq 2156 \text{ mm}$ (*Qualify*)

2. Cross Section Width Requirement (b_w)

- Requirements 1 : $b_w \geq 0,3h$
 $400 \text{ mm} \geq 0,3 \times 600 \text{ mm} = 400 \text{ mm} \geq 180 \text{ mm}$ (*Qualify*)
- Requirements 2 : $b_w \geq 250 \text{ mm}$
 $400 \text{ mm} \geq 250 \text{ mm}$ (*Qualify*)

3. Requirements for the width of the beam to the width of the column

$$c_1 \geq b_w \leq 0,75 \times c_2$$
$$750 \geq 400 \leq 0,75 \times 750 = 750 \geq 400 \text{ mm} \leq 562,5 \text{ mm}$$
 (*Qualify*)

3.2 Mass Modals Partisipations

From the output of the *Autodesk Robot Structural Analysis Professional*, mass participation reaches more than 90%, for the X direction it is in mode 12 and for the Y direction it is in mode 10 with a maximum period of 0,99 Sec and a maximum frequency of 5,9 Hz . It can be concluded based on the provisions of SNI 1726:2019 Chapter 7.9.1 Page 77 that mass modals participation has met the requirements.

3.3 Base Shear

From the output of the Autodesk Robot Structural Analysis Professional get the base shear check refers to SNI 1726:2019 Chapter 7.9.1.4.1 Page 78, as follows :

X Direction Base Shear Check :

V Dinamic > 100% × V Static
524259,33 > 100% × 524259,33
524259,33 > 524259,33 (Qualify)

Y Direction Base Shear Check :



V Dinamic > 100% × V Static
524259,33 > 100% × 524259,33
524259,33 > 524259,33 (Qualify)

3.4 Beam Reinforcement

3.4.1 Beam Reinforcement Detail (BI1-291/X Direction)

The following is a table of reinforcement output recapitulation obtained from RSAP which is then checked against SNI regulations 2847:2019 Chapter 10.5.1.1 Page 214 that $\phi M_n \geq M_u$, as follows :

Table 4 Recapitulation of flexural beam reinforcement calculations (BI1-291/X Direction)

Area	Reinforcement (RSAP)			Mn (N.mm)	Mr (N.mm)	Mu (N.mm)	Check
	$\phi T = 22 \text{ mm}$	As	A's	$(A_s \times f_y) \times \left(d - \frac{a}{2}\right)$	$\phi \times Mn$	RSAP Output	$Mr \geq Mu$
Support		6	3	441447088	397302379	365877304	Qualify
Span		3	3	246798226	222118403	216677448	Qualify

1. Support Beam Flexural Reinforcement Checked

• Reinforcement Ratio Check

Given :

$$R_n = 3,498 \text{ Mpa} \rightarrow \rho_{\text{needed}} = \frac{0,85F_c}{F_y} \times \left(1 - \sqrt{1 - \frac{2R_n}{0,85F_c}} \right)$$

$$\rho_{\text{needed}} = \frac{0,85 \times 30}{420} \times \left(1 - \sqrt{1 - \frac{2 \times 3,498}{0,85 \times 30}} \right) = 0,00899$$

Minimum reinforcement ratio :

$$\rho_{\min 1} = \frac{0,25\sqrt{F_c}}{F_y} = \frac{0,25\sqrt{30}}{420} = 0,00326$$

$$\rho_{\min 2} = \frac{1,4}{F_y} = \frac{1,4}{420} = 0,00333$$

$$\rho_{\min} = 0,00333 \text{ (Determined)}$$

Check Reinforcement Ratio is Necessary :

$$\rho_{\text{needed}} > \rho_{\min} = 0,00899 > 0,00333 \text{ (Qualify)}$$

- Spacing Check based on SNI 2847:2019 Chapter 24.3.2 Page 550

Given :

$$S_{\text{clean}} = \frac{b - (2 \times t_s) - (2 \times \phi_s) - (n \times \phi_T)}{n - 1}$$

$$S_{\text{clean}} = \frac{400 - (2 \times 40) - (2 \times 10) - (3 \times 22)}{3 - 1}$$

$$S_{\text{clean}} = 117 \text{ mm} > 40 \text{ mm (Ok)}$$

Reinforcement is installed in 2 layers.

$$C_c = t_s + \phi_s = 40 + 10 = 50 \text{ mm} / F_s = \frac{2}{3} \times F_y = \frac{2}{3} \times 420 = 280 \text{ Mpa}$$

$$S = 380 \times \left(\frac{280}{F_s} \right) - (2,5 \times C_c) < 300 \times \left(\frac{280}{F_s} \right)$$

$$S = 380 \times \left(\frac{280}{280} \right) - (2,5 \times 50) < 300 \times \left(\frac{280}{280} \right)$$

$$S = 255 \text{ mm} < 300 \text{ mm (Qualify)}$$

$$S_{\text{available}} = S_{\text{clean}} < S = 117 \text{ mm} < 255 \text{ mm (Qualify)}$$

2. Span Beam Flexural Reinforcement Checked

- Reinforcement Ratio Check

Given :

$$R_n = 2,072 \text{ Mpa} \rightarrow \rho_{\text{needed}} = \frac{0,85F_c}{F_y} \times \left(1 - \sqrt{1 - \frac{2R_n}{0,85F_c}} \right)$$

$$\rho_{\text{needed}} = \frac{0,85 \times 30}{420} \times \left(1 - \sqrt{1 - \frac{2 \times 2,072}{0,85 \times 30}} \right) = 0,00515$$

Minimum reinforcement ratio :

$$\rho_{\min 1} = \frac{0,25\sqrt{F_c}}{F_y} = \frac{0,25\sqrt{30}}{420} = 0,00326$$

$$\rho_{\min 2} = \frac{1,4}{F_y} = \frac{1,4}{420} = 0,00333$$

$$\rho_{\min} = 0,00333 \text{ (Determine)}$$

Check Reinforcement Ratio is Necessary :

$$\rho_{\text{needed}} > \rho_{\min} = 0,00515 > 0,00333 \text{ (Qualify)}$$

- Spacing Check based on SNI 2847:2019 Chapter 24.3.2 Page 550

Given :

$$S_{\text{clean}} = \frac{b - (2 \times t_s) - (2 \times \phi_s) - (n \times \phi_T)}{n - 1}$$

$$S_{\text{clean}} = \frac{400 - (2 \times 40) - (2 \times 10) - (3 \times 22)}{3 - 1}$$

$$S_{\text{clean}} = 117 \text{ mm} > 40 \text{ mm (Ok)}$$

Reinforcement is installed in 1 layers.

$$C_c = t_s + \phi_s = 40 + 10 = 50 \text{ mm} / F_s = \frac{2}{3} \times F_y = \frac{2}{3} \times 420 = 280 \text{ Mpa}$$

$$S = 380 \times \left(\frac{280}{F_s} \right) - (2,5 \times C_c) < 300 \times \left(\frac{280}{F_s} \right)$$

$$S = 380 \times \left(\frac{280}{280} \right) - (2,5 \times 50) < 300 \times \left(\frac{280}{280} \right)$$

$$S = 255 \text{ mm} < 300 \text{ mm (Qualify)}$$

$$S_{\text{available}} = S_{\text{clean}} < S = 117 \text{ mm} < 255 \text{ mm (Qualify)}$$

3. Beam Shear Reinforcement

Based on the RSAP output, shear reinforcement is 4D22-260 mm in the plastic hinge area and 4D22-270 mm in the critical hinge area. As in the following picture :

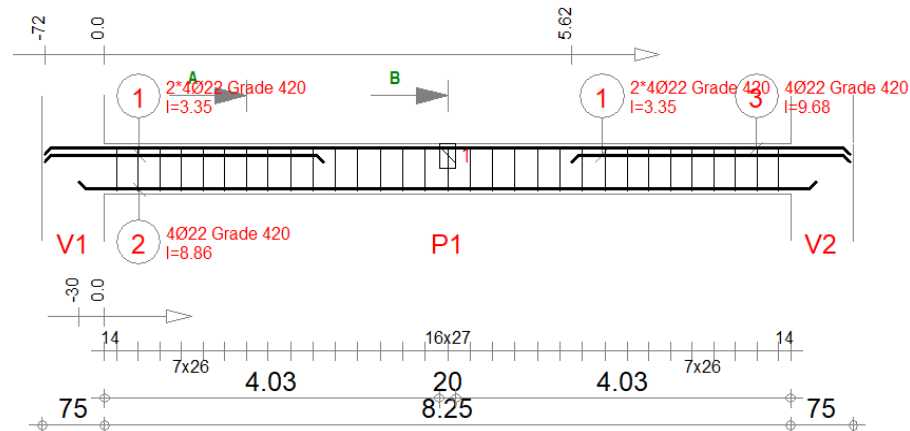


Figure 4 Beam Shear Reinforcement BI1-291
(Source : Autodesk Robot Structural Analysis Profesional, 2022)

Given :

$$V_u = 267732 \text{ N (RSAP Output)}$$

$$V_c \text{ Support} = 0,17\sqrt{F_c} \times b d = 0,17 \times \sqrt{30} \times 400 \times 508 = 189205,28$$

$$V_c \text{ Span} = 0,17\sqrt{F_c} \times b d = 0,17 \times \sqrt{30} \times 400 \times 539 = 200751,27$$

Vs Support Area Analysis

$$V_n = V_c + V_s$$

$$\frac{V_u}{\phi} = V_c + V_s$$

$$189205,28 + V_s = \frac{267732}{0,9}$$

$$V_s \text{ support} = 108274,72 \text{ N}$$

Vs Span Area Analysis

$$V_n = V_c + V_s$$

$$\frac{V_u}{\phi} = V_c + V_s$$

$$200751,27 + V_s = \frac{267732}{0,9}$$

$$V_s \text{ span} = 96728,73 \text{ N}$$

- Spacing Check based on SNI 2847:2019 Chapter 9.7.6.2.2 Page 202

- Support Area

$$\text{Approach 1 : } s \leq \frac{d}{2} \rightarrow s \leq \frac{508}{2} \rightarrow s \leq 254 \text{ mm}$$

$$\text{Approach 2 : } s \leq 600 \text{ mm}$$

Maximum spacing of the shear reinforcement in the support area is 254 mm. Then the shear reinforcement spacing obtained from RSAP output is 260 mm does not meet the requirements.

- Span Area

$$\text{Approach 1 : } s \leq \frac{d}{2} \rightarrow s \leq \frac{539}{2} \rightarrow s \leq 269 \text{ mm}$$

$$\text{Approach 2 : } s \leq 600 \text{ mm}$$

Maximum spacing of the shear reinforcement in the support area is 269 mm. Then the shear reinforcement spacing obtained from RSAP output is 270 mm does not meet the requirements.

- Shear Reinforcement Obtained from SNI Calculations (Conventional) :

Support Area : 3D10 mm – 100 mm

Span Area : 3D10 mm – 200 mm

- Theoretical Area Value



$$A_v \text{ Support} = \frac{V_s \times S}{F_{yt} \times d} = \frac{108274,72 \times 270}{280 \times 508} = 205,53 \text{ mm}^2$$

$$A_v \text{ Span} = \frac{V_s \times S}{F_{yt} \times d} = \frac{96728,73 \times 260}{280 \times 539} = 166,64 \text{ mm}^2$$

3.4.2 Beam Reinforcement Detail (BI2-339/Y Direction)

The following is a table of reinforcement output recapitulation obtained from RSAP which is then checked against SNI regulations 2847:2019 Chapter 10.5.1.1 Page 214 that $\phi M_n \geq M_u$, as follows :

Table 5 Recapitulation of flexural beam reinforcement calculations (BI2-339/Y Direction)

Area	Reinforcement (RSAP)			Mn (N.mm)	Mr (N.mm)	Mu (N.mm)	Check
	ØT = 22 mm	As	A's	$(As \times fy) \times (d - \frac{a}{2})$	Ø × Mn	RSAP Output	Mr ≥ Mu
Support		6	3	339282993	305354694	302491473	Qualify
Span		6	3	257388408	231649557	118977333	Qualify

1. Support Beam Flexural Reinforcement Checked

- Reinforcement Ratio Check

Given :

$$R_n = 4,982 \text{ Mpa} \rightarrow \rho_{\text{needed}} = \frac{0,85F_c}{F_y} \times \left(1 - \sqrt{1 - \frac{2R_n}{0,85F_c}} \right)$$

$$\rho_{\text{needed}} = \frac{0,85 \times 30}{420} \times \left(1 - \sqrt{1 - \frac{2 \times 4,982}{0,85 \times 30}} \right) = 0,0133$$

Minimum reinforcement ratio :

$$\rho_{\text{min 1}} = \frac{0,25\sqrt{F_c}}{F_y} = \frac{0,25\sqrt{30}}{420} = 0,00326$$

$$\rho_{\text{min 2}} = \frac{1,4}{F_y} = \frac{1,4}{420} = 0,00333$$

$\rho_{\text{min}} = 0,00333$ (Determined)

Check Reinforcement Ratio is Necessary :

$\rho_{\text{needed}} > \rho_{\text{min}} = 0,0133 > 0,00333$ (Qualify)

- Spacing Check based on SNI 2847:2019 Chapter 24.3.2 Page 550

Given :

$$S_{\text{clean}} = \frac{b - (2 \times ts) - (2 \times \phi s) - (n \times \phi T)}{n - 1}$$

$$S_{\text{clean}} = \frac{350 - (2 \times 40) - (2 \times 10) - (3 \times 22)}{3 - 1}$$

$$S_{\text{clean}} = 92 \text{ mm} > 40 \text{ mm (Ok)}$$

Reinforcement is installed in 2 layers.

$$Cc = ts + \phi s = 40 + 10 = 50 \text{ mm} / Fs = \frac{2}{3} \times Fy = \frac{2}{3} \times 420 = 280 \text{ Mpa}$$

$$S = 380 \times \left(\frac{280}{Fs} \right) - (2,5 \times Cc) < 300 \times \left(\frac{280}{Fs} \right)$$

$$S = 380 \times \left(\frac{280}{280} \right) - (2,5 \times 50) < 300 \times \left(\frac{280}{280} \right)$$

$$S = 255 \text{ mm} < 300 \text{ mm (Qualify)}$$

$$S_{\text{available}} = S_{\text{clean}} < S = 92 \text{ mm} < 255 \text{ mm (Qualify)}$$

2. Span Beam Flexural Reinforcement Checked

• Reinforcement Ratio Check

Given :

$$Rn = 3,112 \text{ Mpa} \rightarrow \rho_{\text{needed}} = \frac{0,85Fc}{Fy} \times \left(1 - \sqrt{1 - \frac{2Rn}{0,85Fc}} \right)$$

$$\rho_{\text{needed}} = \frac{0,85 \times 30}{420} \times \left(1 - \sqrt{1 - \frac{2 \times 3,112}{0,85 \times 30}} \right) = 0,0079$$

Minimum reinforcement ratio :

$$\rho_{\text{min 1}} = \frac{0,25\sqrt{Fc}}{Fy} = \frac{0,25\sqrt{30}}{420} = 0,00326$$

$$\rho_{\text{min 2}} = \frac{1,4}{Fy} = \frac{1,4}{420} = 0,00333$$

$$\rho_{\text{min}} = 0,00333 \text{ (Determine)}$$

Check Reinforcement Ratio is Necessary :

$$\rho_{\text{needed}} > \rho_{\text{min}} = 0,0079 > 0,00333 \text{ (Qualify)}$$

• Spacing Check based on SNI 2847:2019 Chapter 24.3.2 Page 550

Given :

$$S_{\text{clean}} = \frac{b - (2 \times ts) - (2 \times \phi s) - (n \times \phi T)}{n - 1}$$

$$S_{\text{clean}} = \frac{350 - (2 \times 40) - (2 \times 10) - (3 \times 22)}{3 - 1}$$

$$S_{\text{clean}} = 92 \text{ mm} > 40 \text{ mm (Ok)}$$

Reinforcement is installed in 1 layers.

$$Cc = ts + \phi s = 40 + 10 = 50 \text{ mm} / Fs = \frac{2}{3} \times Fy = \frac{2}{3} \times 420 = 280 \text{ Mpa}$$

$$S = 380 \times \left(\frac{280}{Fs} \right) - (2,5 \times Cc) < 300 \times \left(\frac{280}{Fs} \right)$$

$$S = 380 \times \left(\frac{280}{280} \right) - (2,5 \times 50) < 300 \times \left(\frac{280}{280} \right)$$

$$S = 255 \text{ mm} < 300 \text{ mm (Qualify)}$$

$$S_{\text{available}} = S_{\text{clean}} < S = 92 \text{ mm} < 255 \text{ mm (Qualify)}$$

3. Beam Shear Reinforcement

Based on the RSAP output, shear reinforcement is 4D22-210 mm in the plastic hinge area and 4D22-220 mm in the critical hinge area. As in the following picture :

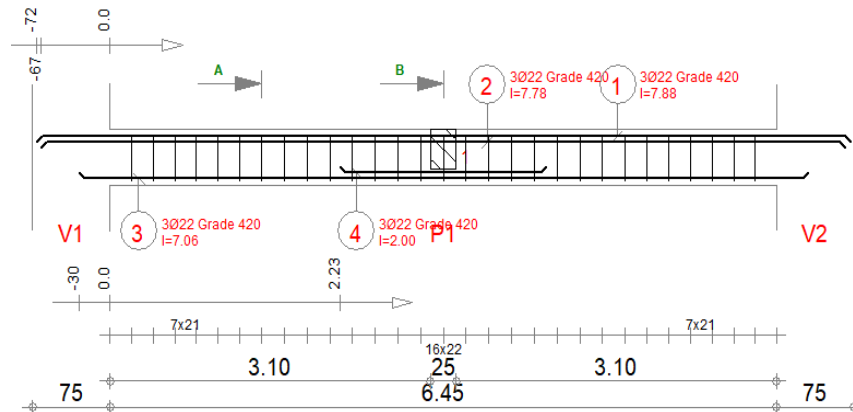


Figure 5 Shear Beam Reinforcement BI2-339
(Source : Autodesk Robot Structural Analysis Profesional, 2022)

Given :

$V_u = 224303$ N (RSAP Output)

$V_c \text{ Support} = 0,17\sqrt{F_c} \times b d = 0,17 \times \sqrt{30} \times 350 \times 408 = 132965,13$

$V_c \text{ Span} = 0,17\sqrt{F_c} \times b d = 0,17 \times \sqrt{30} \times 350 \times 439 = 143067,87$

Vs Support Area Analysis

$V_n = V_c + V_s$

$\frac{V_u}{\phi} = V_c + V_s$

$132965,13 + V_s = \frac{224303}{0,9}$

$V_s \text{ support} = 116260,43$ N

Vs Span Area Analysis

$V_n = V_c + V_s$

$\frac{V_u}{\phi} = V_c + V_s$

$143067,87 + V_s = \frac{224303}{0,9}$

$V_s \text{ span} = 106157,69$ N

- Spacing Check based on SNI 2847:2019 Chapter 9.7.6.2.2 Page 202

- Support Area

Approach 1 : $s \leq \frac{d}{2} \rightarrow s \leq \frac{408}{2} \rightarrow s \leq 204$ mm

Approach 2 : $s \leq 600$ mm

Maximum spacing of the shear reinforcement in the support area is 204 mm.

Then the shear reinforcement spacing obtained from RSAP output is 210 mm does not meet the requirements.

- Span Area

Approach 1 : $s \leq \frac{d}{2} \rightarrow s \leq \frac{439}{2} \rightarrow s \leq 219$ mm

Approach 2 : $s \leq 600$ mm

Maximum spacing of the shear reinforcement in the support area is 219 mm. Then the shear reinforcement spacing obtained from RSAP output is 220 mm does not meet the requirements.

- Shear Reinforcement Obtained from SNI Calculations (Conventional) :

Support Area : 3D10 mm – 100 mm

Span Area : 3D10 mm – 200 mm

- Theoretical Area Value

$$A_v \text{ Support} = \frac{V_s \times S}{F_{yt} \times d} = \frac{116260,43 \times 210}{280 \times 408} = 213,71 \text{ mm}^2$$

$$A_v \text{ Span} = \frac{V_s \times S}{F_{yt} \times d} = \frac{106157,69 \times 220}{280 \times 439} = 189,99 \text{ mm}^2$$

4. CONCLUSION

1. The optimum design of the elongated main beam / X direction using the *Robot Structural Analysis Profesional* obtains the following reinforcement results :

- Longitudinal Reinforcement :

Support Reinforcement : $A_s = 6\text{-D}22 \text{ mm} / A'_s = 3\text{-D}22 \text{ mm}$

Span Reinforcement : $A_s = 3\text{-D}22 \text{ mm} / A'_s = 3\text{-D}22 \text{ mm}$

- Shear Reinforcement :

Plastic Hinge Area : 4D10 mm – 260 mm

Critical Hinge Area : 4D10 mm – 270 mm

Because the width of the shear reinforcement spacing result from RSAP output does not meet the requirements of SNI 2847:2019 Chapter 9.7.6.2.2, then the shear reinforcement in the design used the result from SNI calculations, namely : 3D10 mm – 100 mm in plastic hinge area and 3D10 mm – 200 mm in critical hinge area.

2. The optimum design of the elongated main beam / Y direction using the *Robot Structural Analysis Profesional* obtains the following reinforcement results :

- Longitudinal Reinforcement :

Support Reinforcement : $A_s = 6\text{-D}22 \text{ mm} / A'_s = 3\text{-D}22 \text{ mm}$

Span Reinforcement : $A_s = 6\text{-D}22 \text{ mm} / A'_s = 3\text{-D}22 \text{ mm}$

- Shear Reinforcement :

Plastic Hinge Area : 4D10 mm – 210 mm

Critical Hinge Area : 4D10 mm – 220 mm

Because the width of the shear reinforcement spacing result from RSAP output does not meet the requirements of SNI 2847:2019 Chapter 9.7.6.2.2, then the shear reinforcement in the design used the result from SNI calculations, namely : 3D10 mm – 100 mm in plastic hinge area and 3D10 mm – 200 mm in critical hinge area.

3. Based on the output of the beam reinforcement results, designing a building based on the building information modeling (BIM) method using the *Robot Structural Analysis Professional* software can be summarized as follows :
 - *Robot Structural Analysis Professional* Software for beam optimal design can be said to be more wasteful than manual check calculation results using SNI 2847:2019 (conventional). This is due to limitations in adjusting the amount of reinforcement that cannot be changed in the *Robot Structural Analysis Professional* software.
 - Beam reinforcement in RSAP obtains reinforcement spacing values that are greater than manual calculations. However, the spacing obtained from the RSAP results is too large so it does not meet the requirements of SNI 2847:2019.
 - Because software that supports the BIM method can be integrated at every stage or project file, used BIM-based software for beam optimal design is more time efficient and easier to run than conventional software.

5. REFERENCE

- Christian. (2017). *Aplikasi Building Information Modeling (BIM) dalam Perancangan Bangunan Beton Bertulang 4 Lantai*. Fakultas Teknik Universitas Kristen Maranatha, Bandung.
- Marizan, Y. (2019). Studi Literatur Tentang Penggunaan Software Autodesk Revit Studi Kasus Perencanaan Puskesmas Sukajadi Kota Prabumulih. *Jurnal Ilmiah Bering's*, 06(01), 15–26.
- Badan Standarisasi Nasional. 2019. SNI 2847-2019 tentang Persyaratan Beton Struktural untuk Bangunan Gedung. Jakarta : Badan Standarisasi Nasional.
- Badan Standarisasi Nasional. 2019. SNI 03-1726-2019 tentang Tata Cara Perencanaan Ketahanan Gempa untuk Struktur Bangunan Gedung dan Non-gedung. Jakarta : Badan Standarisasi Nasional.
- Lesmana, Y. (2019). *Konsep dan Desain Sistem Rangka Momen Khusus (SRMK) Beton Bertulang Tahan Gempa Berdasarkan SNI 2847:2013 & SNI1726:2012*. Surabaya: Deepublish.
- Rizky, R.M. (2021). Perbandingan Metode Konvensional Dengan BIM Terhadap Efisiensi Biaya, Mutu, Waktu. *Construction and Material Journal*, 03(01), 15-24.
- Nugroho, M. T. (2020). Perancangan Detail Engineering Design Gedung Bertingkat Berbasis Building Information Modeling (Studi Kasus : Asrama Institut Teknologi Sumatera). *Media Komunikasi Teknik Sipil*, 00(00).
- Sangaji, S., Kristiawan, S.A., & Saputra, I.K (2019). Pengaplikasian Building Information Modeling (BIM) Dalam Desain Bangunan Gedung. *Jurnal Matriks Teknik Sipil*, 381-386.
- Wahiddin. (2012). Aplikasi Robot Structural Analysis Program (RSAP) 2012 pada Perencanaan Struktur Rangka. *PROKONS Jurusan Teknik Sipil*, 6(1), 38-45.
- Wahiddin. (2019). Aplikasi Rsap 2019 Pada Analisis Beban Gempa Statik Ekuivalen Berdasarkan Sni 1726-2012. *PROKONS Jurusan Teknik Sipil*, 12(2), 116-121.
-